

## HEATING RELAY (RELAYHEAT) SELECTION

The QFlo UTC is equipped with two internal relays: one exclusively for cooling and the other for connecting to external systems, such as a heat source or a pump, as demonstrated in this example. Users can select from three additional modes: "Heat," "Pump," or "Off," where the "Off" mode applies specifically to the two external sources. This guide provides step-by-step instructions to help users configure these settings, ensuring reliable and efficient temperature control tailored to their specific needs.

- Pump – pressure pump is running.
- Heat – heating element is on.
- Off – both pump and heat are off.

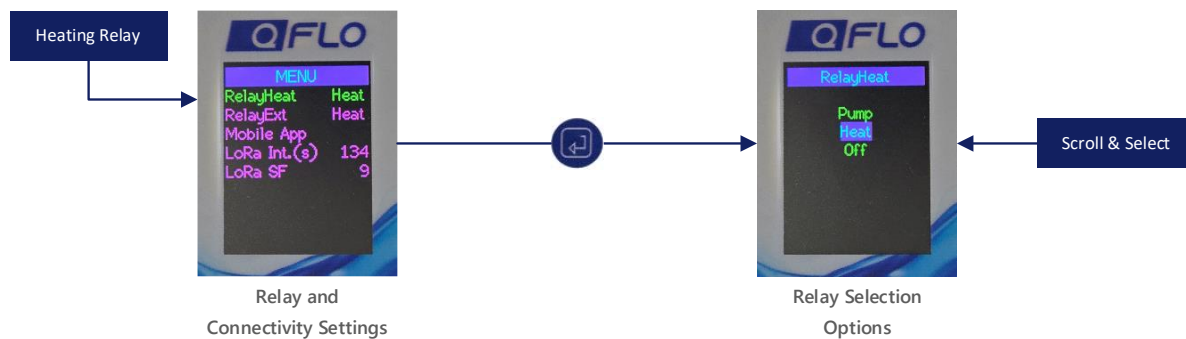


Figure 1: Heating Relay Displays

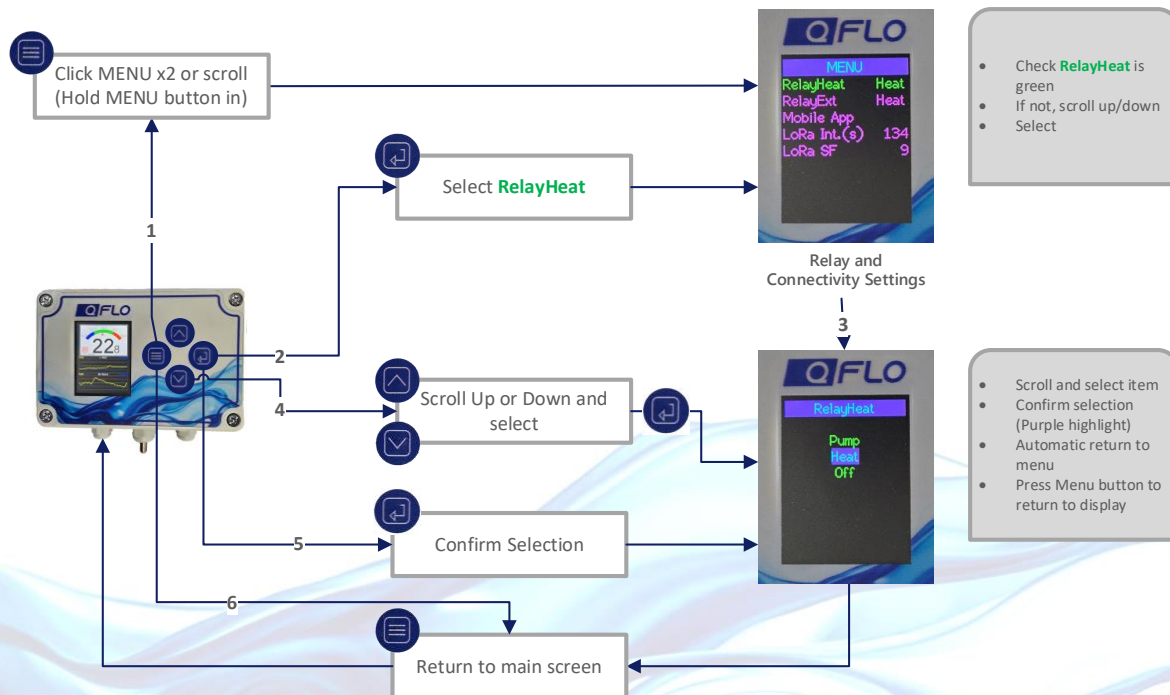


Figure 2: Heating Relay Selection Process